

PLAN

GENERAL NOTES:


PROVIDE MINIMUM OF 18" OF CLEARANCE AROUND CLEANOUT

SADDLES SHALL BE USED AT ALL CONNECTIONS TO CLAY SEWER MAIN

SANITARY SERVICES RISERS SHALL BE CONSTRUCTED WHERE MAIN DEPTH EXCEEDS 12".

FOR SANITARY SEWER MAIN THAT IS LINED, A PROPER SITTING SHALL BE USED FOR THE LINER.

CLEAN OUT ADAPTOR (HUB) WITH RAISED MIPT PLUG
 LOCKING SEWER CLEAN OUT FRAME AND LID TO BE SET AT FINISH GRADE

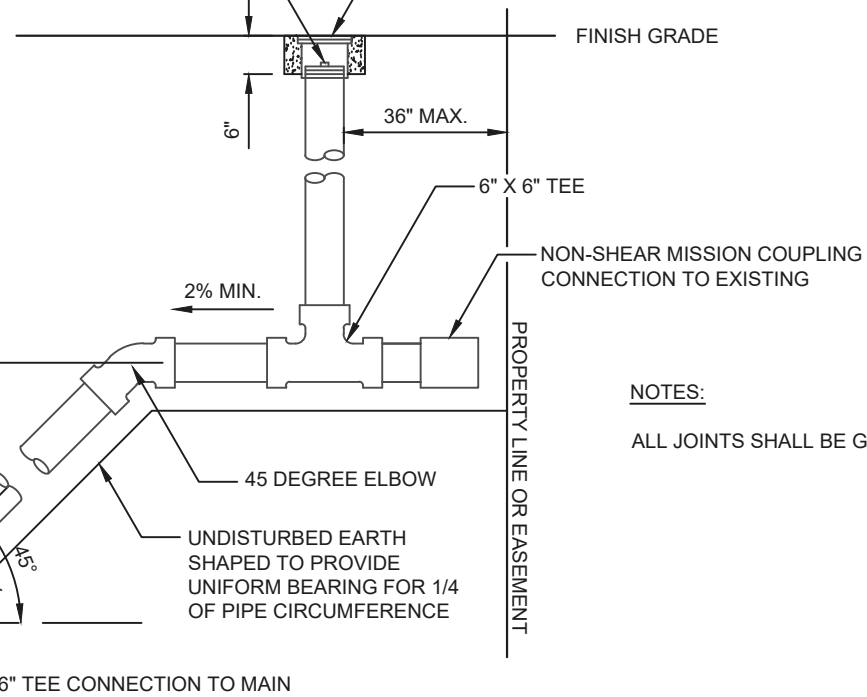

SECTION A-A

NOTES:

ALL JOINTS SHALL BE GASKETED

INVERT OF LATERAL SHALL BE NO LOWER THAN CROWN OF MAIN

6" MIN (TYP)

6" MIN

UNDISTURBED EARTH SHAPED TO PROVIDE UNIFORM BEARING FOR 1/4 OF PIPE CIRCUMFERENCE

PROPERTY LINE OR EASEMENT

SEE TRENCH SECTIONS DETAILS

STANDARD SAN-003



CITY OF WEST CHICAGO
 475 MAIN STREET
 WEST CHICAGO, IL 60185
 PHONE: 630-293-2255
 FAX: 630-293-2971

SANITARY SEWER SERVICES CONNECTION

CITY OF WEST CHICAGO
 CONSTRUCTION SPECIFICATIONS,
 STANDARDS, AND DETAILS

REVISIONS
