

GENERAL NOTES:

NOTIFY PUBLIC WORKS UTILITY DIVISION 48 HOURS PRIOR TO START OF CONSTRUCTION.


COORDINATE WATER SHUTDOWN WITH THE PUBLIC WORKS DEPARTMENT, EXCAVATE AREA AND DISCONNECT HYDRANT LEAD, PLATE TEE, BLOCK AND RESTRAIN.

RETURN HYDRANT, AUXILIARY VALVE AND BOX TO PUBLIC WORKS DEPARTMENT.

BACKFILL AND COMPACT PER CITY STANDARD.

THE PLUG SHALL BE MECHANICAL JOINT.

ALL FASTENERS HARDWARE (I.E., NUTS, BOLTS, AND WASHERS) ASSOCIATED WITH THE PLUG SHALL BE STAINLESS STEEL.

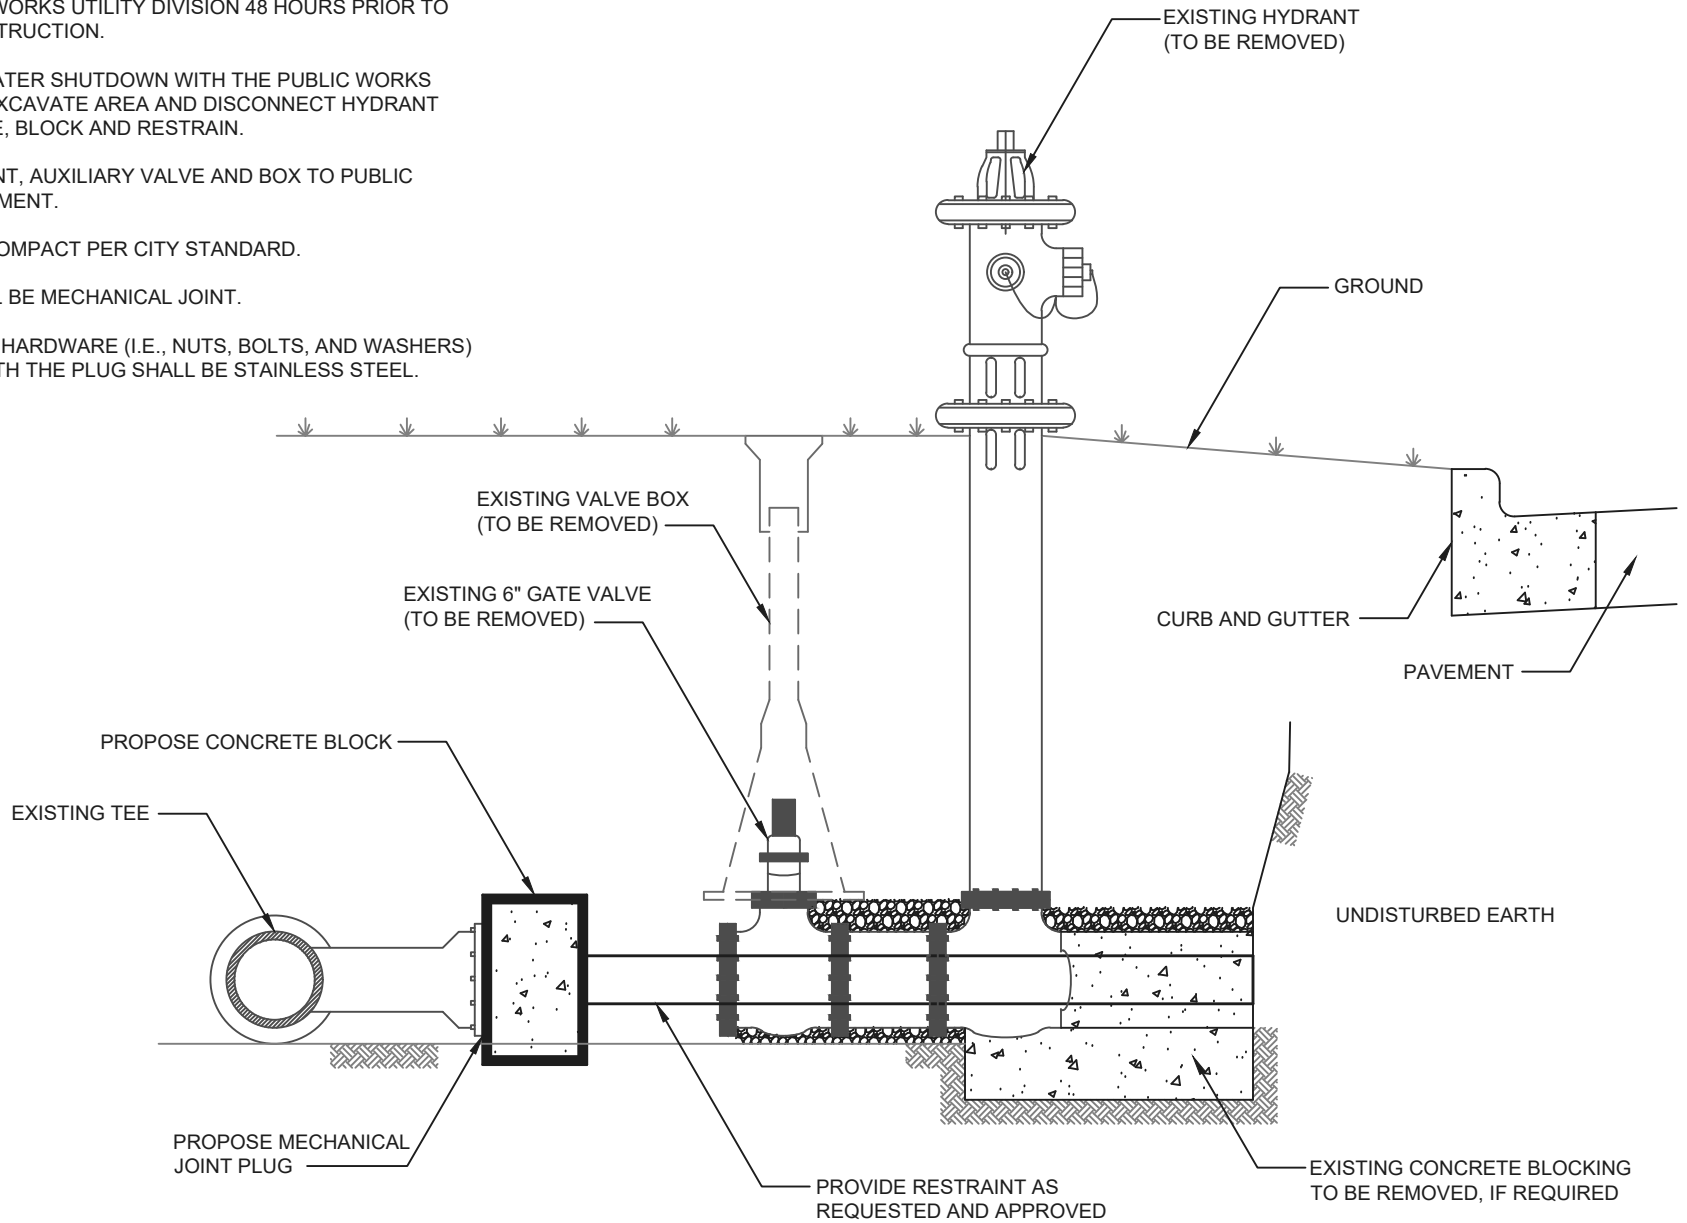

STANDARD WM-005



CITY OF WEST CHICAGO
 475 MAIN STREET
 WEST CHICAGO, IL 60185
 PHONE: 630-293-2255
 FAX: 630-293-2971

FIRE HYDRANT ABANDONMENT

CITY OF WEST CHICAGO
 CONSTRUCTION SPECIFICATIONS,
 STANDARDS, AND DETAILS

REVISIONS

NO.	DATE	DESCRIPTION